


Underground ASME containers (This figure for illustrative purposes only; local code shall govern)

Figure 3*

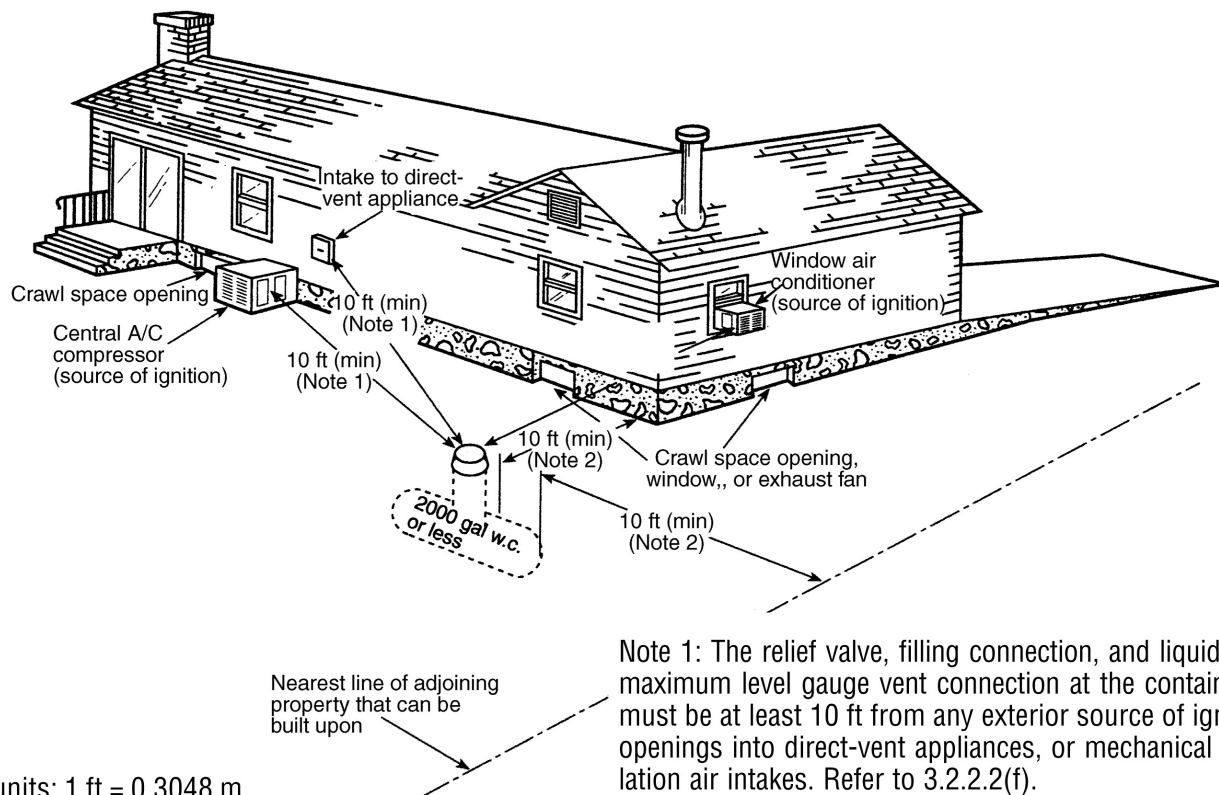

Note 1: The relief valve, filling connection, and liquid fixed maximum level gauge vent connection at the container must be at least 10 ft from any exterior source of ignition, openings into direct-vent appliances, or mechanical ventilation air intakes. Refer to 3.2.2.2(f).

Note 2: No part of an underground container shall be less than 10 ft from an important building or line of adjoining property that may be built upon. Refer to 3.2.2.2(f).